



Chilled Wet Wall Testing

Greenhouse Temperatures

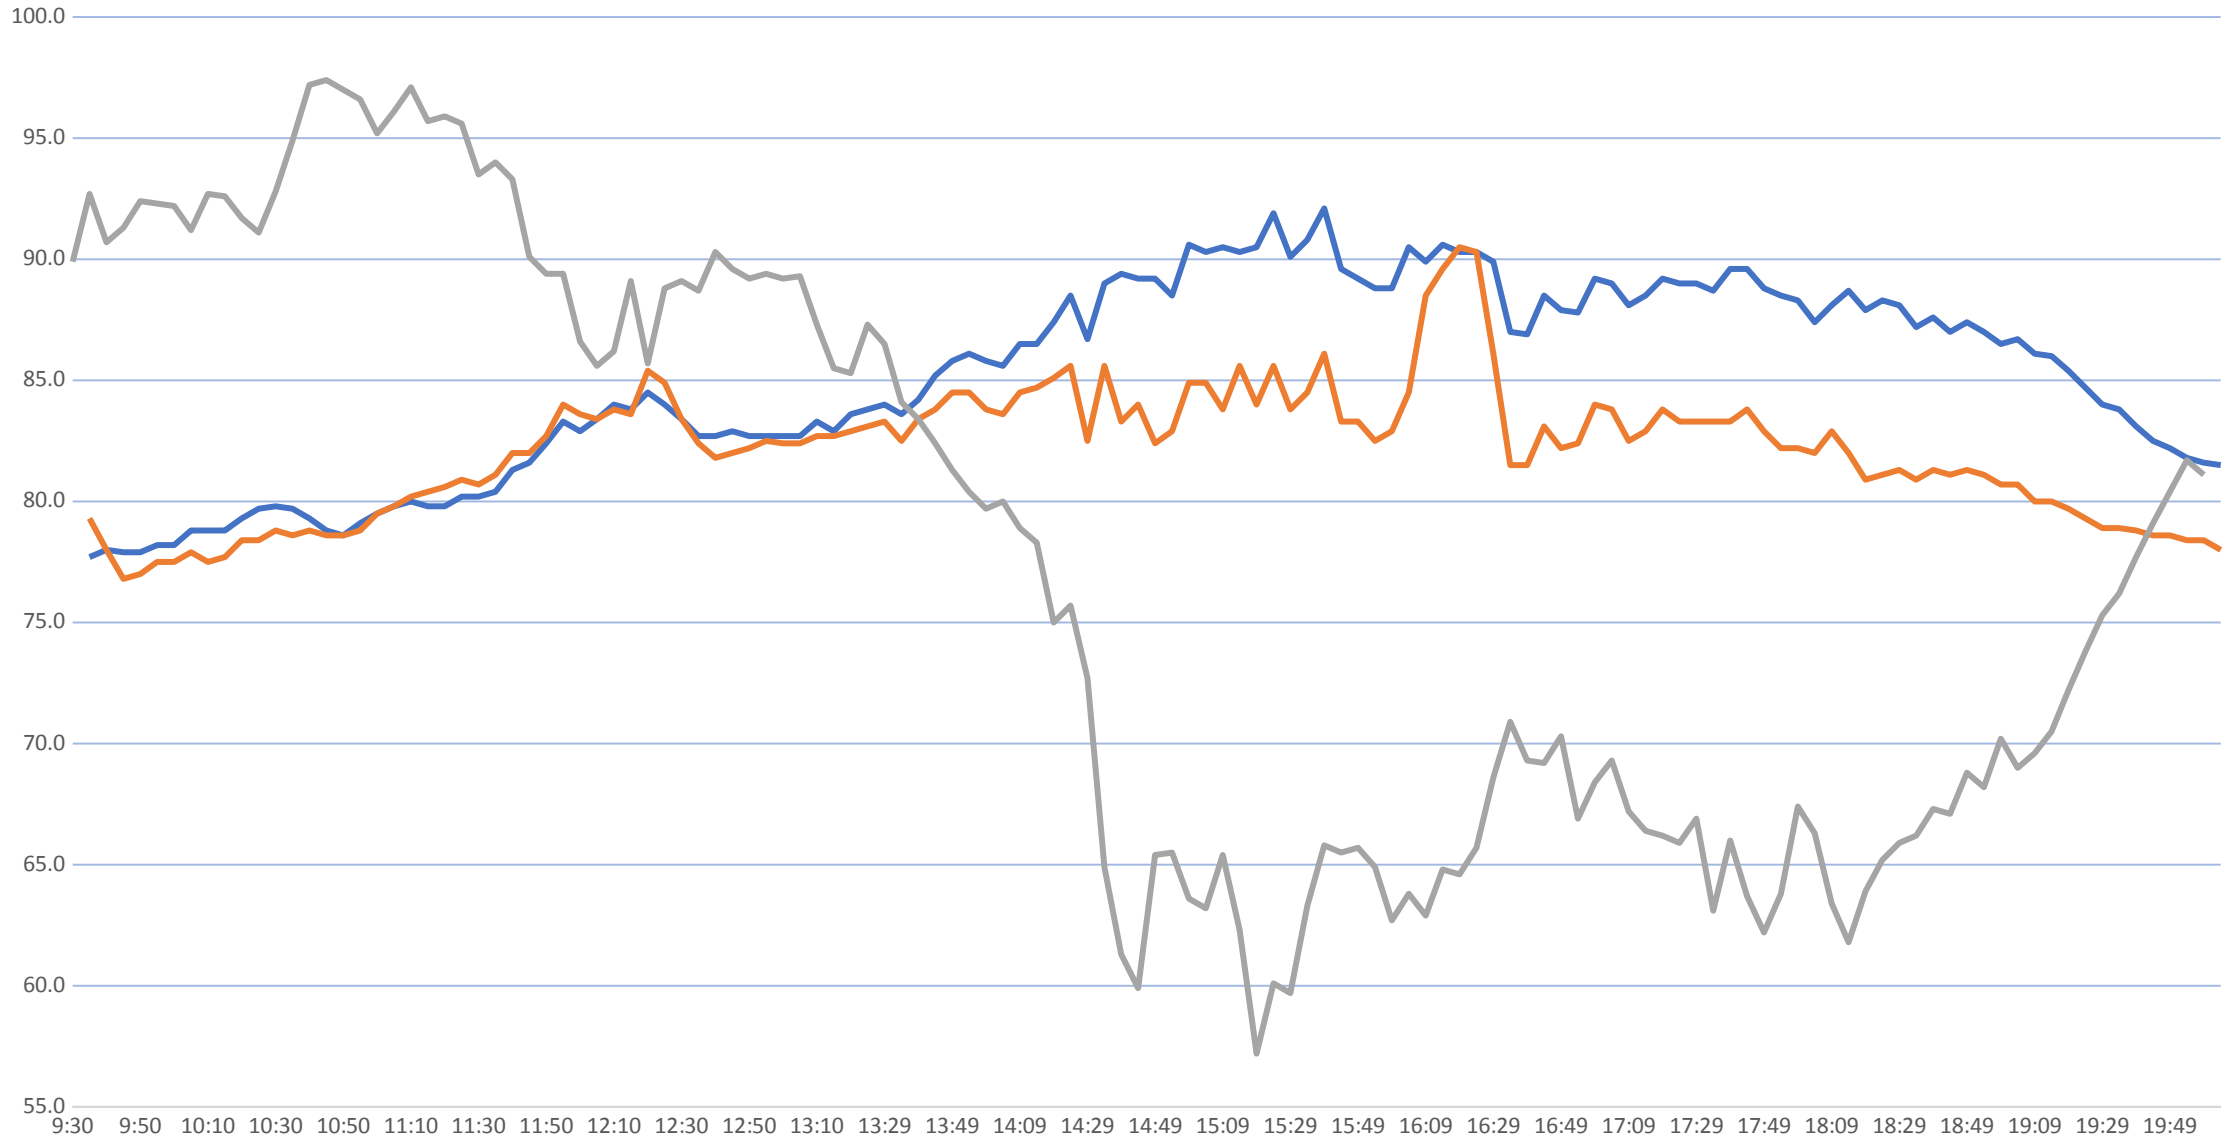

— Outside Temp °F — Inside Temp °F — Outside RH

Greenhouse Temperatures

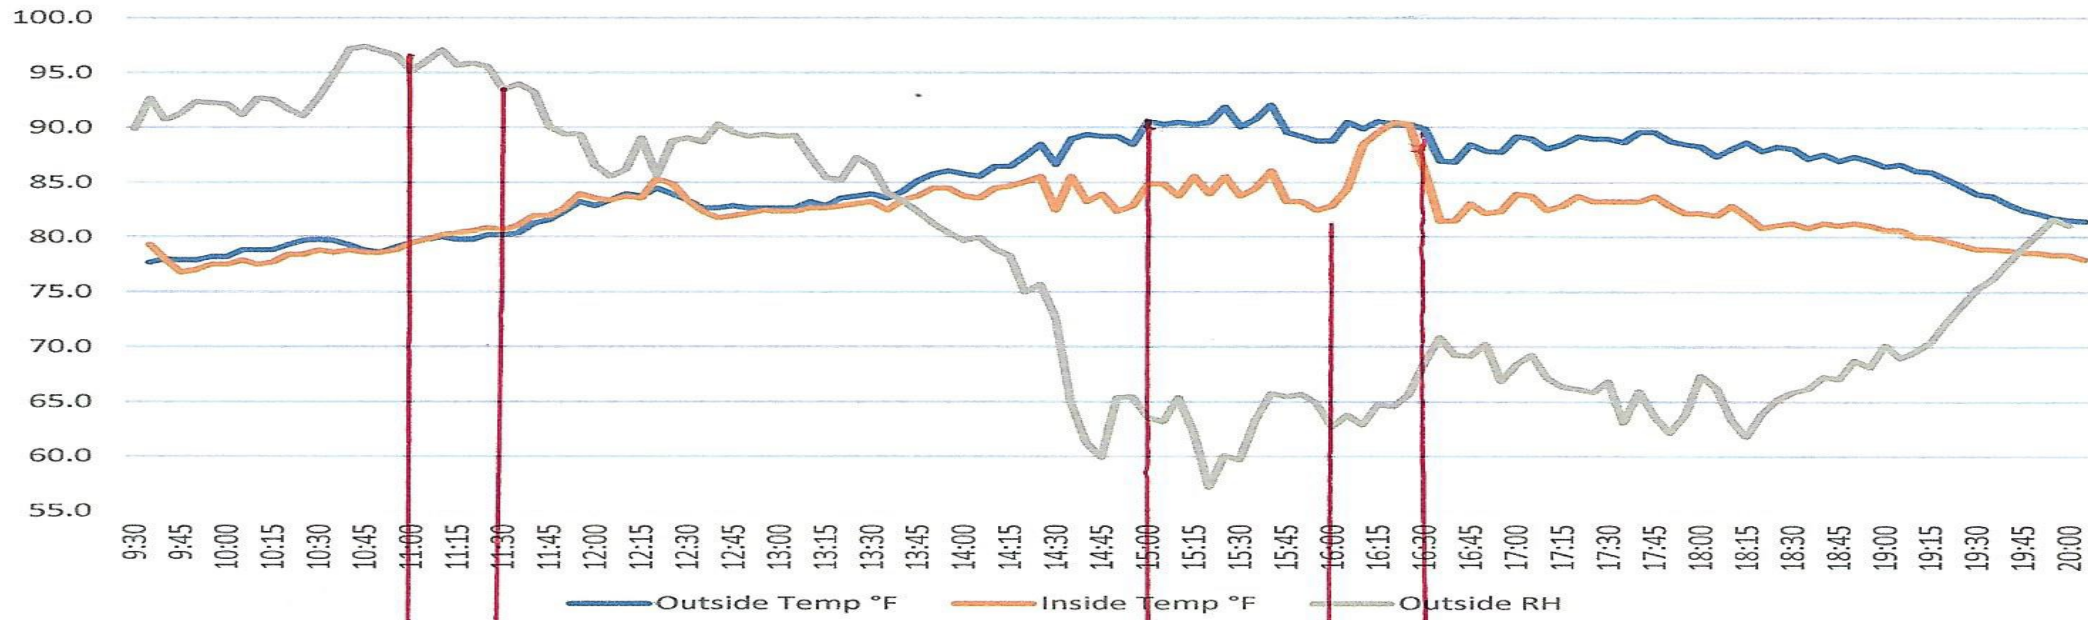

Chillers Started
Logger

Chillers Started

Chillers Turned Off

Fans Turned Off

Chiller Restarted
Fans On